


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, February 16, 2015**

**Section 1
Island Interconnected System Supply and Demand
Actual 24 Hour System Performance For Friday, February 13, 2015**

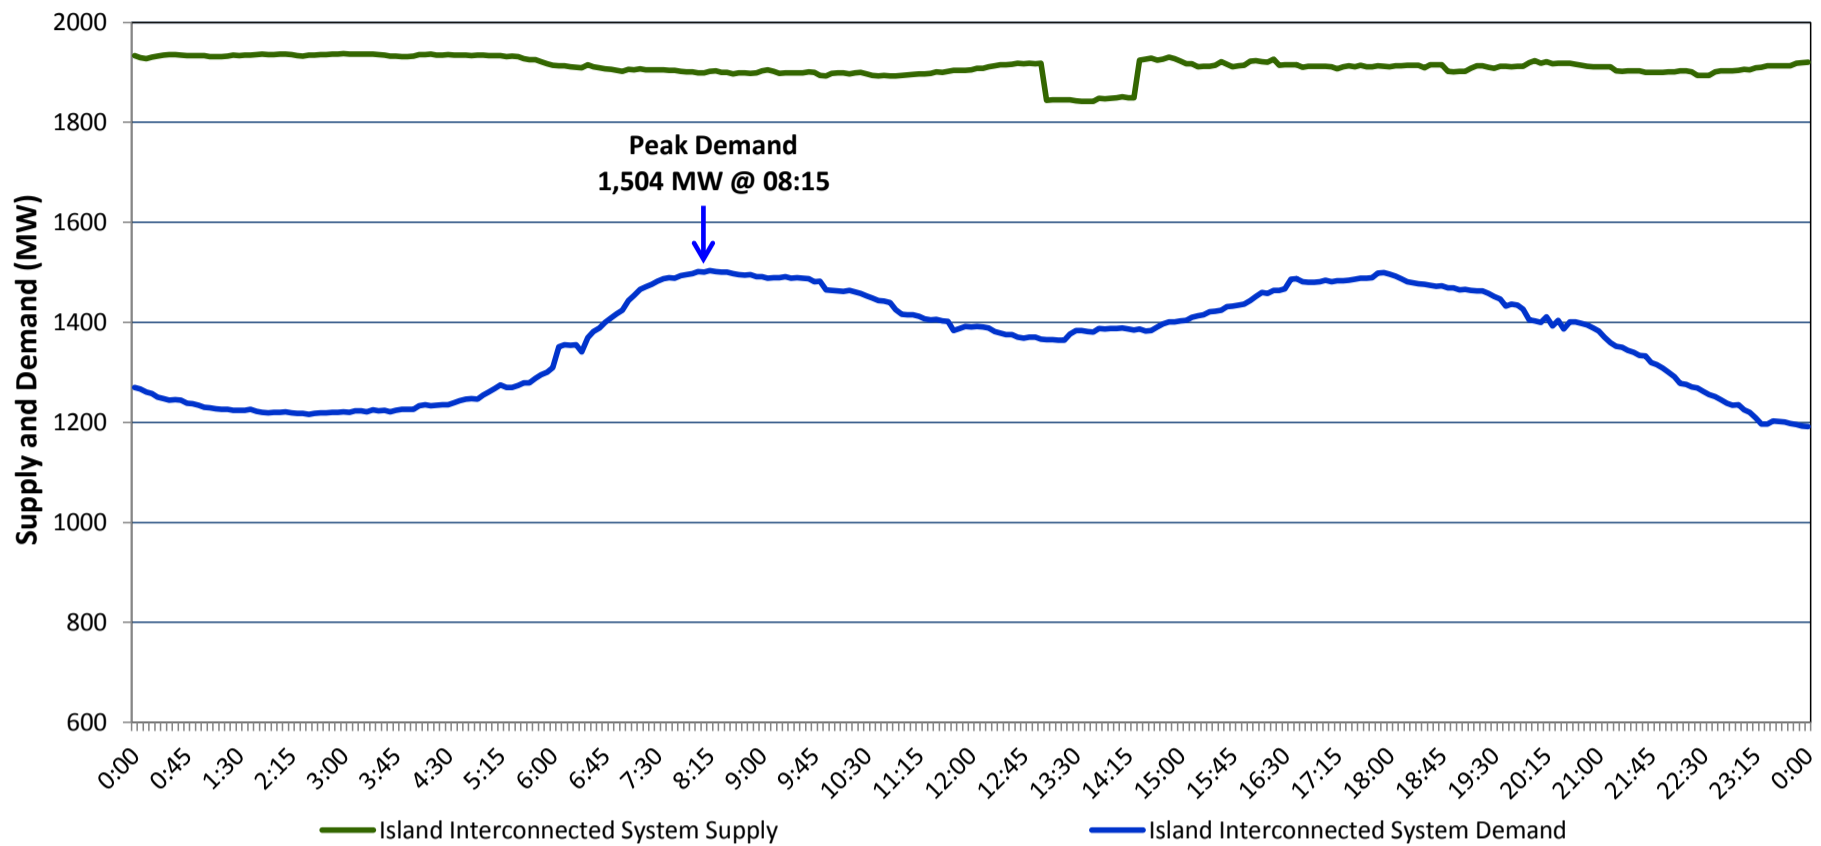

Supply Notes For February 13, 2015 ^{1,2}

- A As of 1016 hours, January 30, 2015, St. Anthony Diesel Plant G5 (Unit 546) unavailable (2 MW).
- B At 1305 hours, February 13, 2015, the Hinds Lake Unit was removed from service (75 MW).
- C At 1424 hours, February 13, 2015, the Hinds Lake Unit was returned to service (75 MW).

**Section 2
Island Interconnected Supply and Demand**

Sat, Feb 14, 2015	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁶
Available Island System Supply: ⁵	1,925 MW	Saturday, February 14, 2015	-5	-7	1,470	1,375
NLH Generation: ⁴	1,565 MW	Sunday, February 15, 2015	-10	-1	1,435	1,340
NLH Power Purchases:	160 MW	Monday, February 16, 2015	5	-4	1,560	1,460
Other Island Generation:	200 MW	Tuesday, February 17, 2015	-6	-8	1,585	1,485
Current St. John's Temperature:	-6 °C	Wednesday, February 18, 2015	-9	-1	1,570	1,470
Current St. John's Windchill:	-16 °C	Thursday, February 19, 2015	4	-1	1,330	1,235
7-Day Island Peak Demand Forecast:	1,585 MW	Friday, February 20, 2015	-1	-6	1,495	1,400

Supply Notes For February 14, 2015 ³

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as underfrequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Underfrequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. Adjusted for CBP&P interruptible load (when applicable) and the impact of voltage reduction.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Fri, Feb 13, 2015	Actual Island Peak Demand ⁷	08:15	1,504 MW
Sat, Feb 14, 2015	Forecast Island Peak Demand		1,470 MW

Notes: 7. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).