


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Friday, April 21, 2017**

**Section 1
Island Interconnected System Supply and Demand
Actual 24 Hour System Performance For Thursday, April 20, 2017**

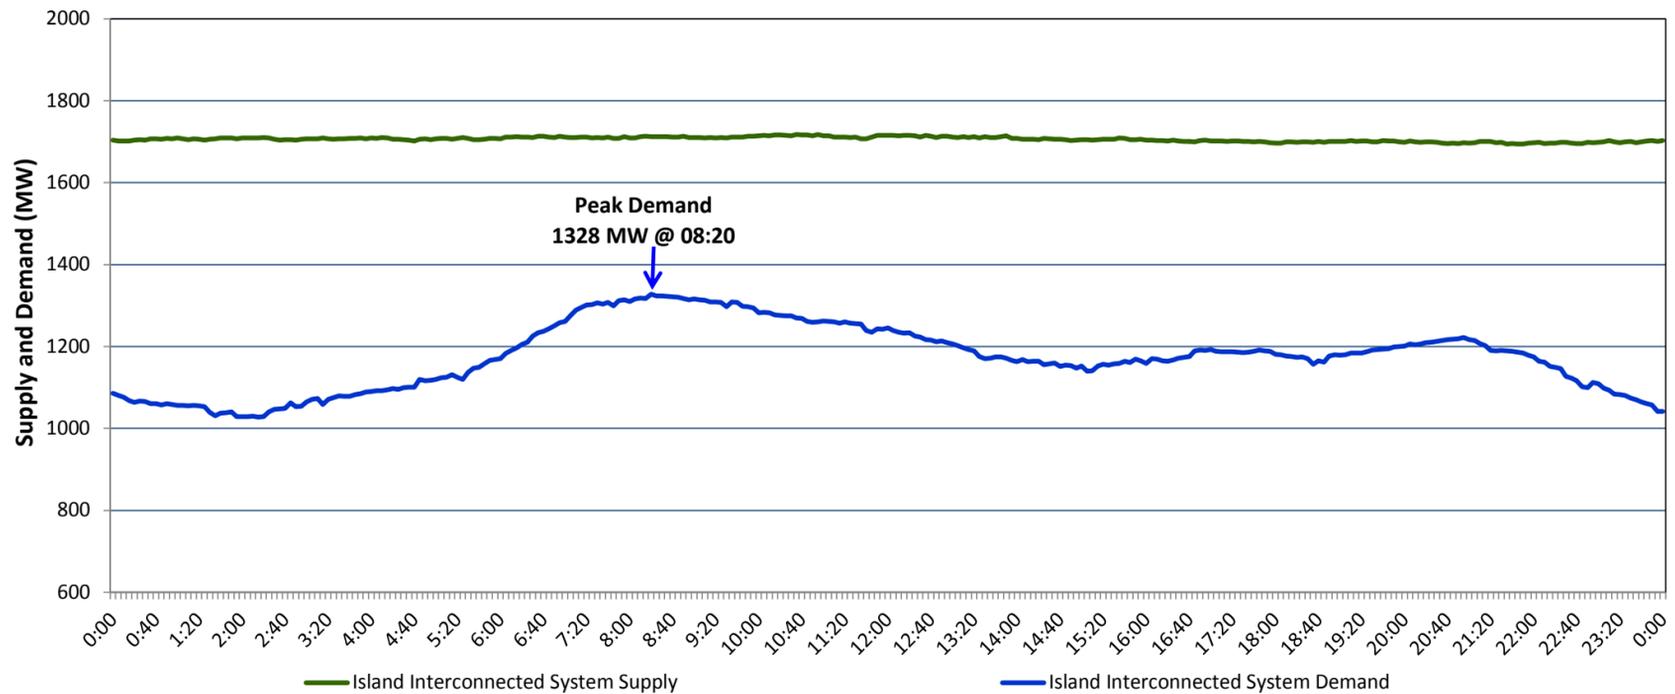

Supply Notes For April 20, 2017

1,2

- A As of 0829 hours, March 31, 2017, Holyrood Unit 1 available at 135 MW (170 MW).
- B As of 0829 hours, March 31, 2017, Holyrood Unit 3 available at 135 MW (150 MW).
- C As of 1526 hours, April 03, 2017, Stephenville Gas Turbine available at 25 MW (50 MW).
- D As of 2151 hours, April 07, 2017, Holyrood Unit 2 unavailable due to planned outage 130 MW (170 MW).
- E As of 1520 hours, April 19, 2017, Hawke's Bay Diesel Plant available at 2.5 MW (5 MW).
- F As of 2021 hours, April 19, 2017, Hinds Lake Unit unavailable (75 MW).

**Section 2
Island Interconnected Supply and Demand**

Fri, Apr 21, 2017	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW) Forecast
			Morning	Evening	
Available Island System Supply: ⁵	1,695 MW	Friday, April 21, 2017	0	0	1,320
NLH Generation: ⁴	1,370 MW	Saturday, April 22, 2017	1	0	1,240
NLH Power Purchases: ⁶	110 MW	Sunday, April 23, 2017	1	2	1,150
Other Island Generation:	215 MW	Monday, April 24, 2017	3	6	1,080
Current St. John's Temperature:	-1 °C	Tuesday, April 25, 2017	-2	-1	1,250
Current St. John's Windchill:	-7 °C	Wednesday, April 26, 2017	2	3	1,205
7-Day Island Peak Demand Forecast:	1,320 MW	Thursday, April 27, 2017	5	10	1,090

Supply Notes For April 21, 2017

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island Interconnected System being isolated from the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Vale capacity assistance (when applicable), and Wind Generation.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Thu, Apr 20, 2017	Actual Island Peak Demand ⁸	08:20	1,328 MW
Fri, Apr 21, 2017	Forecast Island Peak Demand		1,320 MW

- Notes: 8. Island Demand is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).