


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Thursday, March 15, 2018**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Wednesday, March 14, 2018**

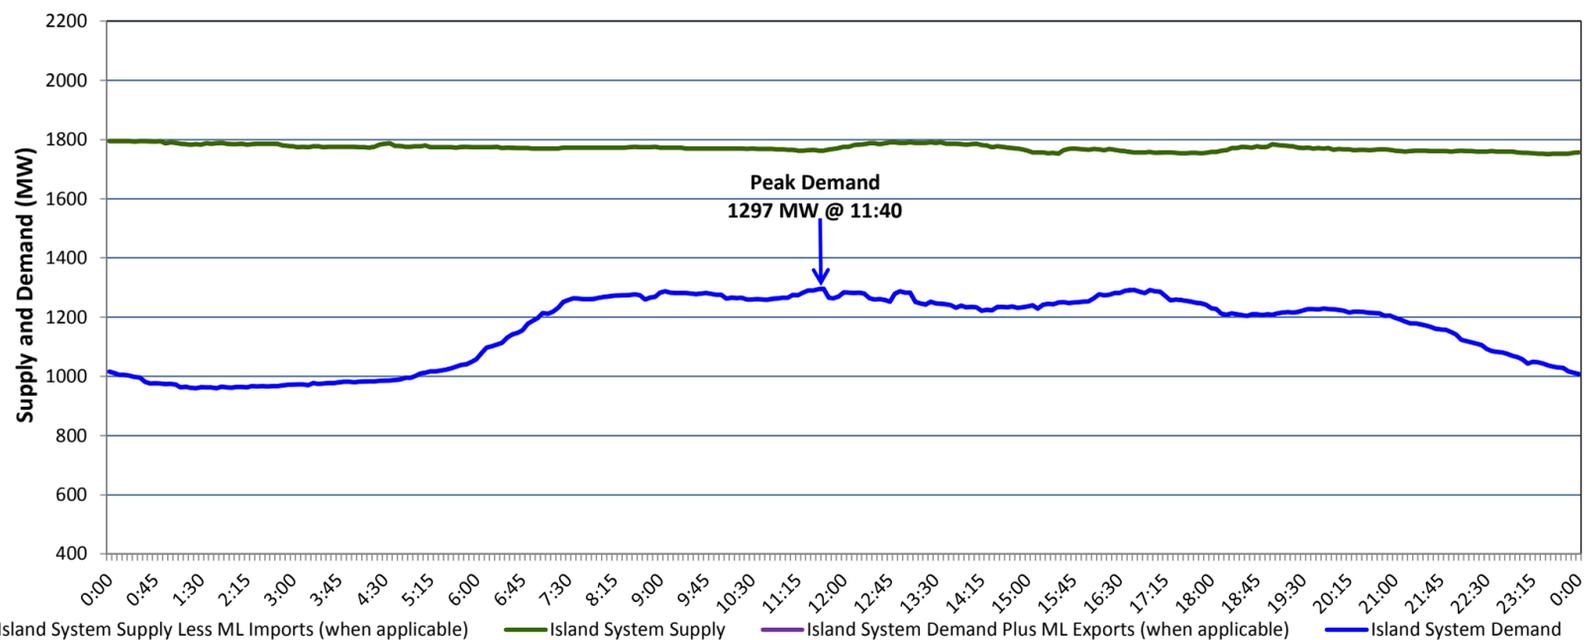

Supply Notes For March 14, 2018

1,2

- A As of 2115 hours, January 04, 2018, Stephenville Gas Turbine available at 25 MW (50 MW).
- B As of 0844 hours, March 01, 2018, Holyrood Unit 1 available at 148 MW (170 MW).
- C As of 1733 hours, March 06, 2018, Holyrood Unit 2 available at 100 MW (170 MW).
- D As of 2231 hours, March 13, 2018, Holyrood Unit 3 removed from service for economic dispatch 100 MW (150 MW).

**Section 2
Island Interconnected Supply and Demand**

Thu, Mar 15, 2018	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,775 MW	Thursday, March 15, 2018	2	2	1,265	1,159
NLH Generation: ⁴	1,425 MW	Friday, March 16, 2018	1	0	1,270	1,164
NLH Power Purchases: ⁶	145 MW	Saturday, March 17, 2018	-3	-2	1,300	1,194
Maritime Link Imports:	- MW	Sunday, March 18, 2018	-2	-4	1,425	1,317
Other Island Generation:	205 MW	Monday, March 19, 2018	-3	-3	1,415	1,307
Current St. John's Temperature & Windchill:	1 °C	Tuesday, March 20, 2018	-2	-3	1,390	1,283
7-Day Island Peak Demand Forecast:	1,425 MW	Wednesday, March 21, 2018	-2	0	1,350	1,243

Supply Notes For March 15, 2018

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island System having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units some customer's load must be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding, is necessary to ensure the integrity and reliability of system equipment. Under frequency events typically occur 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation, Vale capacity assistance (when applicable).
 7. Adjusted for CBP&P, Vale and Praxair interruptible load, Maritime Link Exports and the impact of voltage reduction (when applicable).

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, Mar 14, 2018	Actual Island Peak Demand ⁸	11:40	1,297 MW
Thu, Mar 15, 2018	Forecast Island Peak Demand		1,265 MW

- Notes: 8. Island Demand / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).