


Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Friday, February 22, 2019

Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Thursday, February 21, 2019

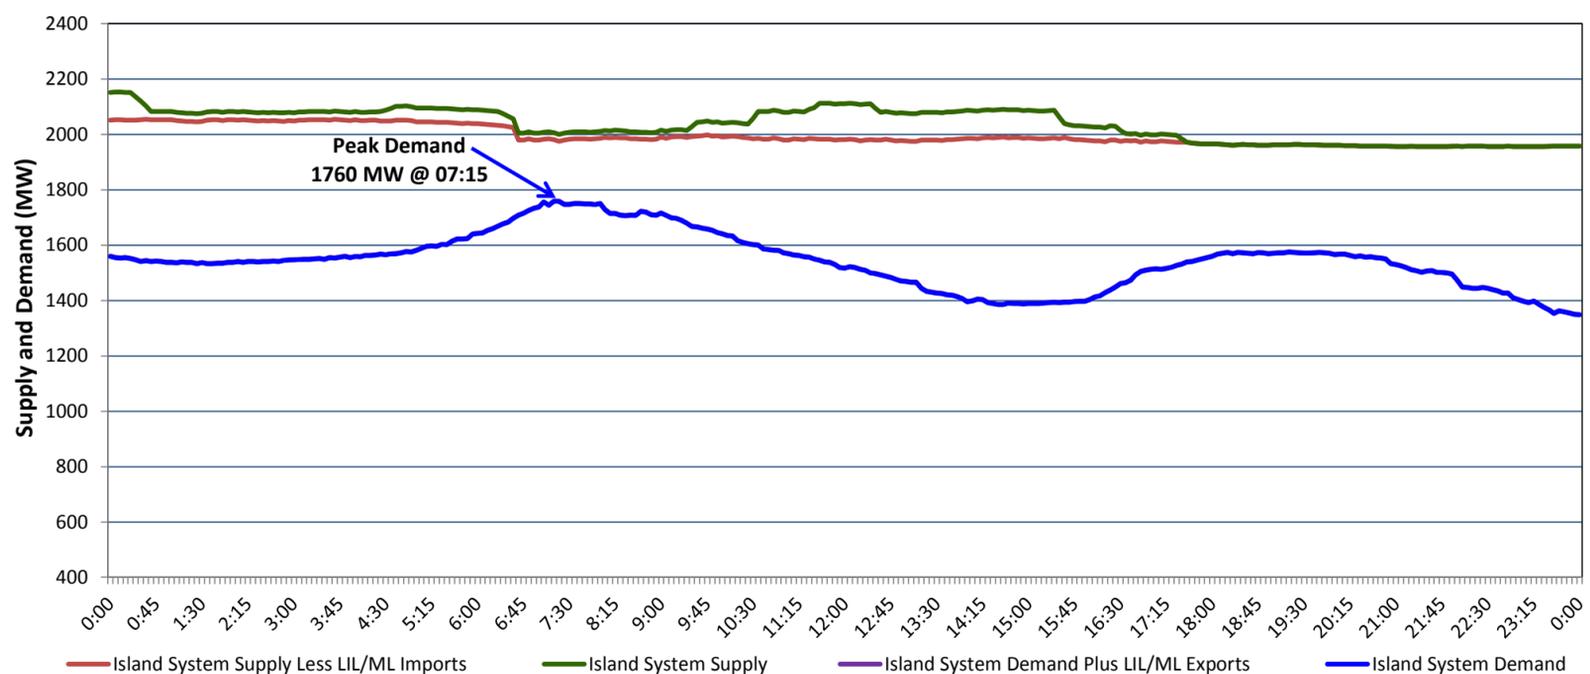

Supply Notes For February 21, 2019

1,2

- A At 0639 hours, February 21, 2019, Hardwoods Gas Turbine unavailable (50 MW).
 B At 0708 hours, February 21, 2019, St. Anthony Diesel Plant available at 7.7 MW (9.7 MW).
 C At 1528 hours, February 21, 2019, St. Anthony Diesel Plant available at full capacity (9.7 MW).

Section 2 Island Interconnected Supply and Demand

Fri, Feb 22, 2019	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	2,015 MW	Friday, February 22, 2019	-11	-8	1,670	1,565
NLH Island Generation: ⁴	1,645 MW	Saturday, February 23, 2019	-16	-13	1,645	1,540
NLH Island Power Purchases: ⁶	115 MW	Sunday, February 24, 2019	-13	-12	1,575	1,471
Other Island Generation:	205 MW	Monday, February 25, 2019	-9	-2	1,570	1,466
ML/LIL Imports:	50 MW	Tuesday, February 26, 2019	-2	-7	1,545	1,441
Current St. John's Temperature & Windchill:	-12 °C	Wednesday, February 27, 2019	-10	-7	1,605	1,500
7-Day Island Peak Demand Forecast:	1,670 MW	Thursday, February 28, 2019	-9	-9	1,605	1,500

Supply Notes For February 22, 2019

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Thu, Feb 21, 2019	Actual Island Peak Demand ⁸	07:15	1,760 MW
Fri, Feb 22, 2019	Forecast Island Peak Demand		1,670 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).