


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, May 04, 2020**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Sunday, May 03, 2020**

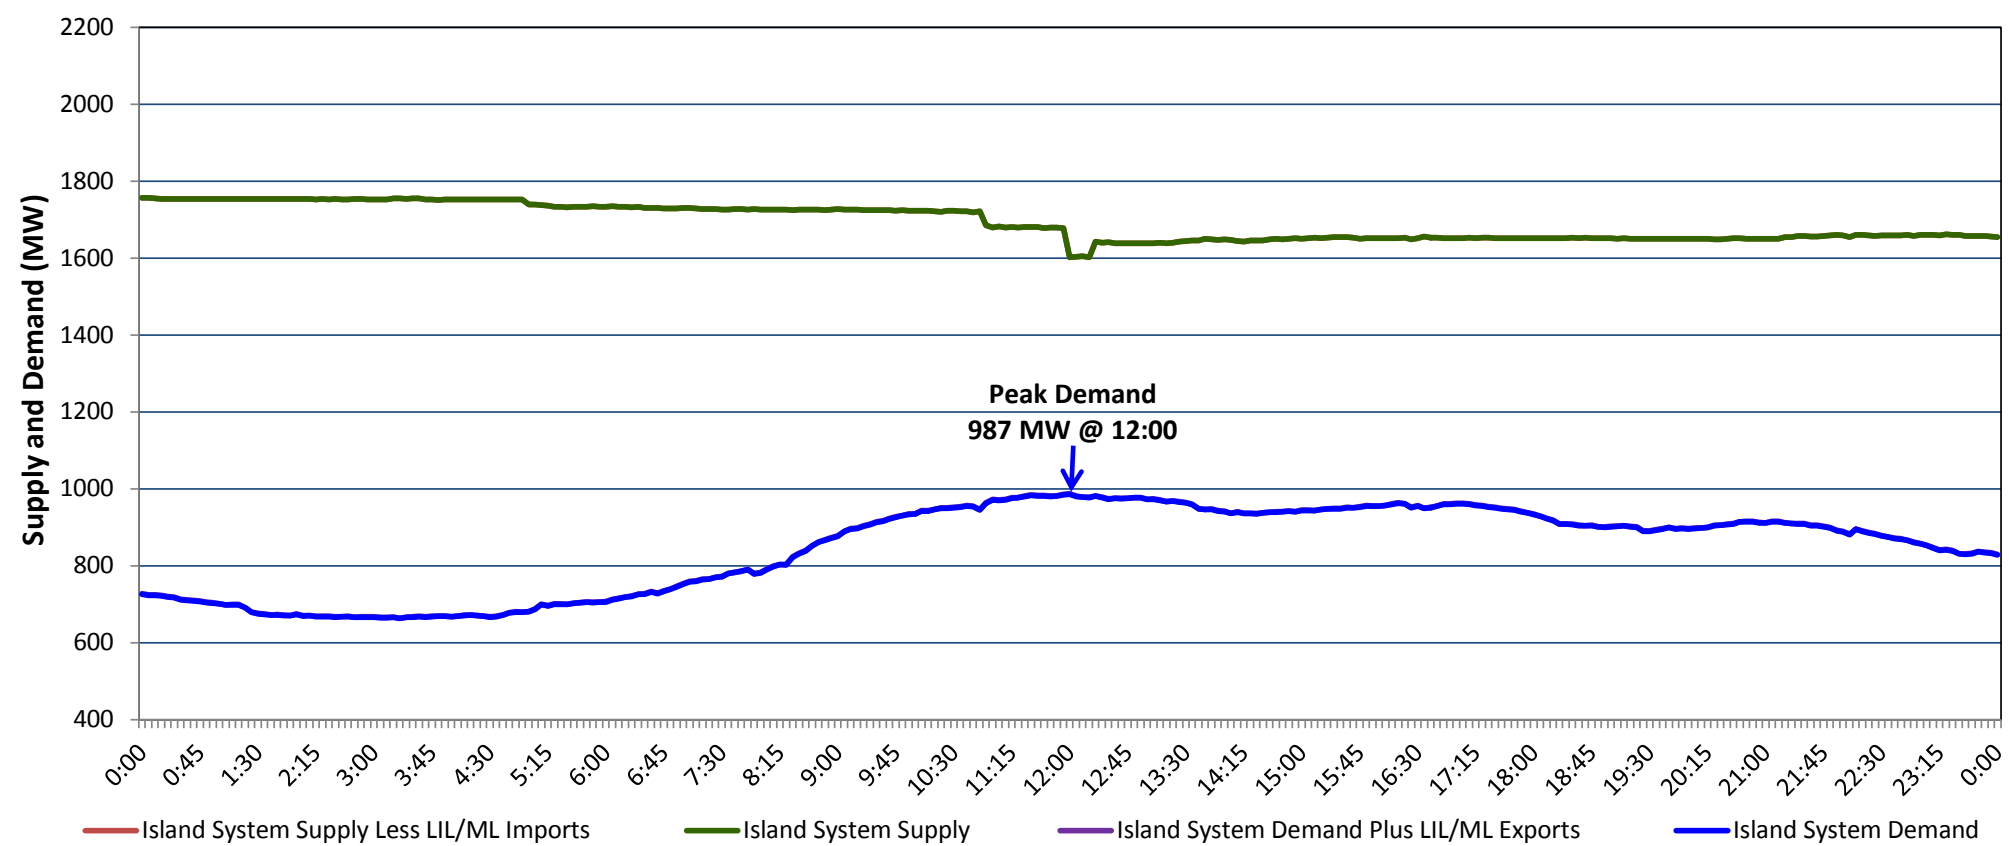

Supply Notes For May 03, 2020

- 1,2
- A As of 0847 hours, March 19, 2020, Holyrood Diesels available at 8 MW (10 MW).
 - B As of 1245 hours, April 24, 2020, Holyrood Unit 3 unavailable due to planned outage (150 MW).
 - C As of 1009 hours, May 01, 2020, Holyrood Unit 1 available but not operating (170 MW).
 - D At 1054 hours, May 03, 2020, Granite Canal Unit unavailable due to planned outage (40 MW).
 - E At 1200 hours, May 03, 2020, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
 - F At 1220 hours, May 03, 2020, Granite Canal Unit available (40 MW).

**Section 2
Island Interconnected Supply and Demand**

Mon, May 04, 2020	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,655 MW	Monday, May 04, 2020	2	3	1,040	1,040
NLH Island Generation: ⁴	1,295 MW	Tuesday, May 05, 2020	1	4	1,170	1,170
NLH Island Power Purchases: ⁶	140 MW	Wednesday, May 06, 2020	3	3	1,020	1,020
Other Island Generation:	220 MW	Thursday, May 07, 2020	2	4	1,060	1,060
ML/LIL Imports:	- MW	Friday, May 08, 2020	3	7	1,080	1,080
Current St. John's Temperature & Windchill:	1 °C	Saturday, May 09, 2020	4	6	1,010	1,010
7-Day Island Peak Demand Forecast:	1,170 MW	Sunday, May 10, 2020	3	5	985	985

Supply Notes For May 04, 2020

- 3
- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Sun, May 03, 2020	Actual Island Peak Demand ⁸	12:00	987 MW
Mon, May 04, 2020	Forecast Island Peak Demand		1,040 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).