


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Thursday, May 14, 2020**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Wednesday, May 13, 2020**

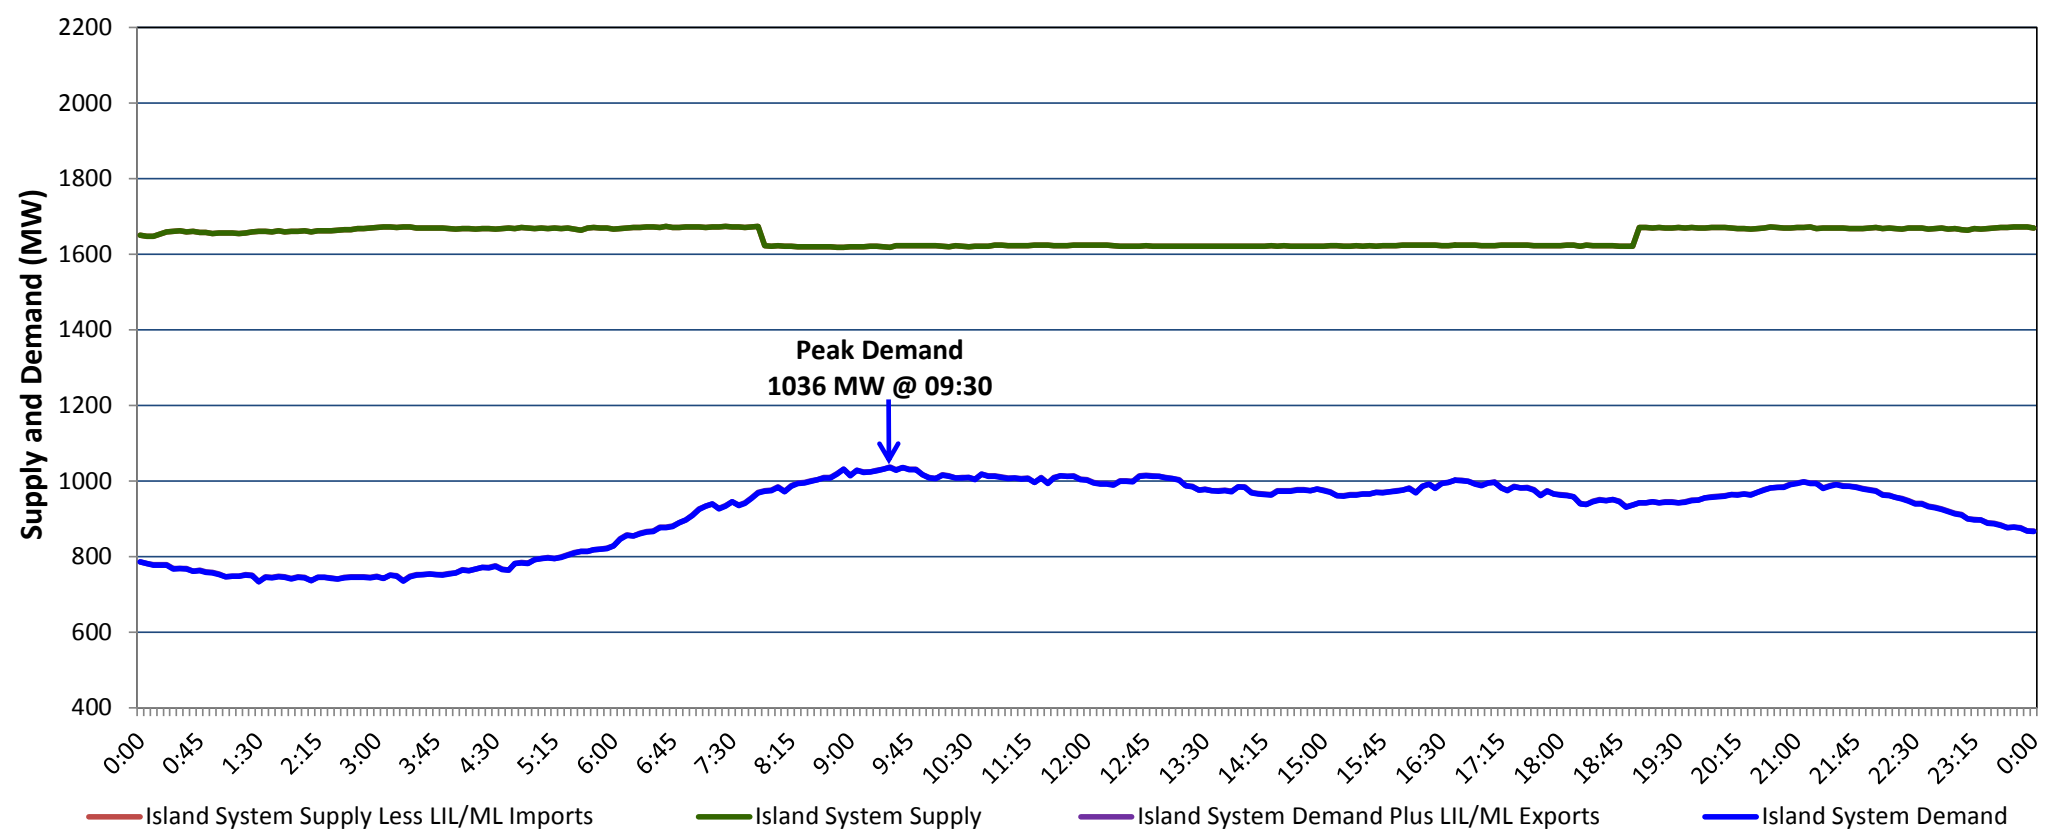

Supply Notes For May 13, 2020

1,2

- A As of 1245 hours, April 24, 2020, Holyrood Unit 3 unavailable due to planned outage (150 MW).
- B As of 1009 hours, May 01, 2020, Holyrood Unit 1 available but not operating (170 MW).
- C As of 1200 hours, May 03, 2020, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- D At 0753 hours, May 13, 2020, Stephenville Gas Turbine unavailable due to planned outage (50 MW).
- E At 1856 hours, May 13, 2020, Stephenville Gas Turbine available (50 MW).

**Section 2
Island Interconnected Supply and Demand**

Thu, May 14, 2020	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,665 MW	Thursday, May 14, 2020	2	1	1,075	1,075
NLH Island Generation: ⁴	1,295 MW	Friday, May 15, 2020	3	3	1,055	1,055
NLH Island Power Purchases: ⁶	150 MW	Saturday, May 16, 2020	3	2	1,010	1,010
Other Island Generation:	220 MW	Sunday, May 17, 2020	3	2	1,000	1,000
ML/LIL Imports:	- MW	Monday, May 18, 2020	2	3	1,000	1,000
Current St. John's Temperature & Windchill:	2 °C	Tuesday, May 19, 2020	4	3	990	990
7-Day Island Peak Demand Forecast:	1,075 MW	Wednesday, May 20, 2020	7	10	895	895

Supply Notes For May 14, 2020

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Wed, May 13, 2020	Actual Island Peak Demand ⁸	09:30	1,036 MW
Thu, May 14, 2020	Forecast Island Peak Demand		1,075 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).