


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, July 06, 2020**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Friday, July 03, 2020**

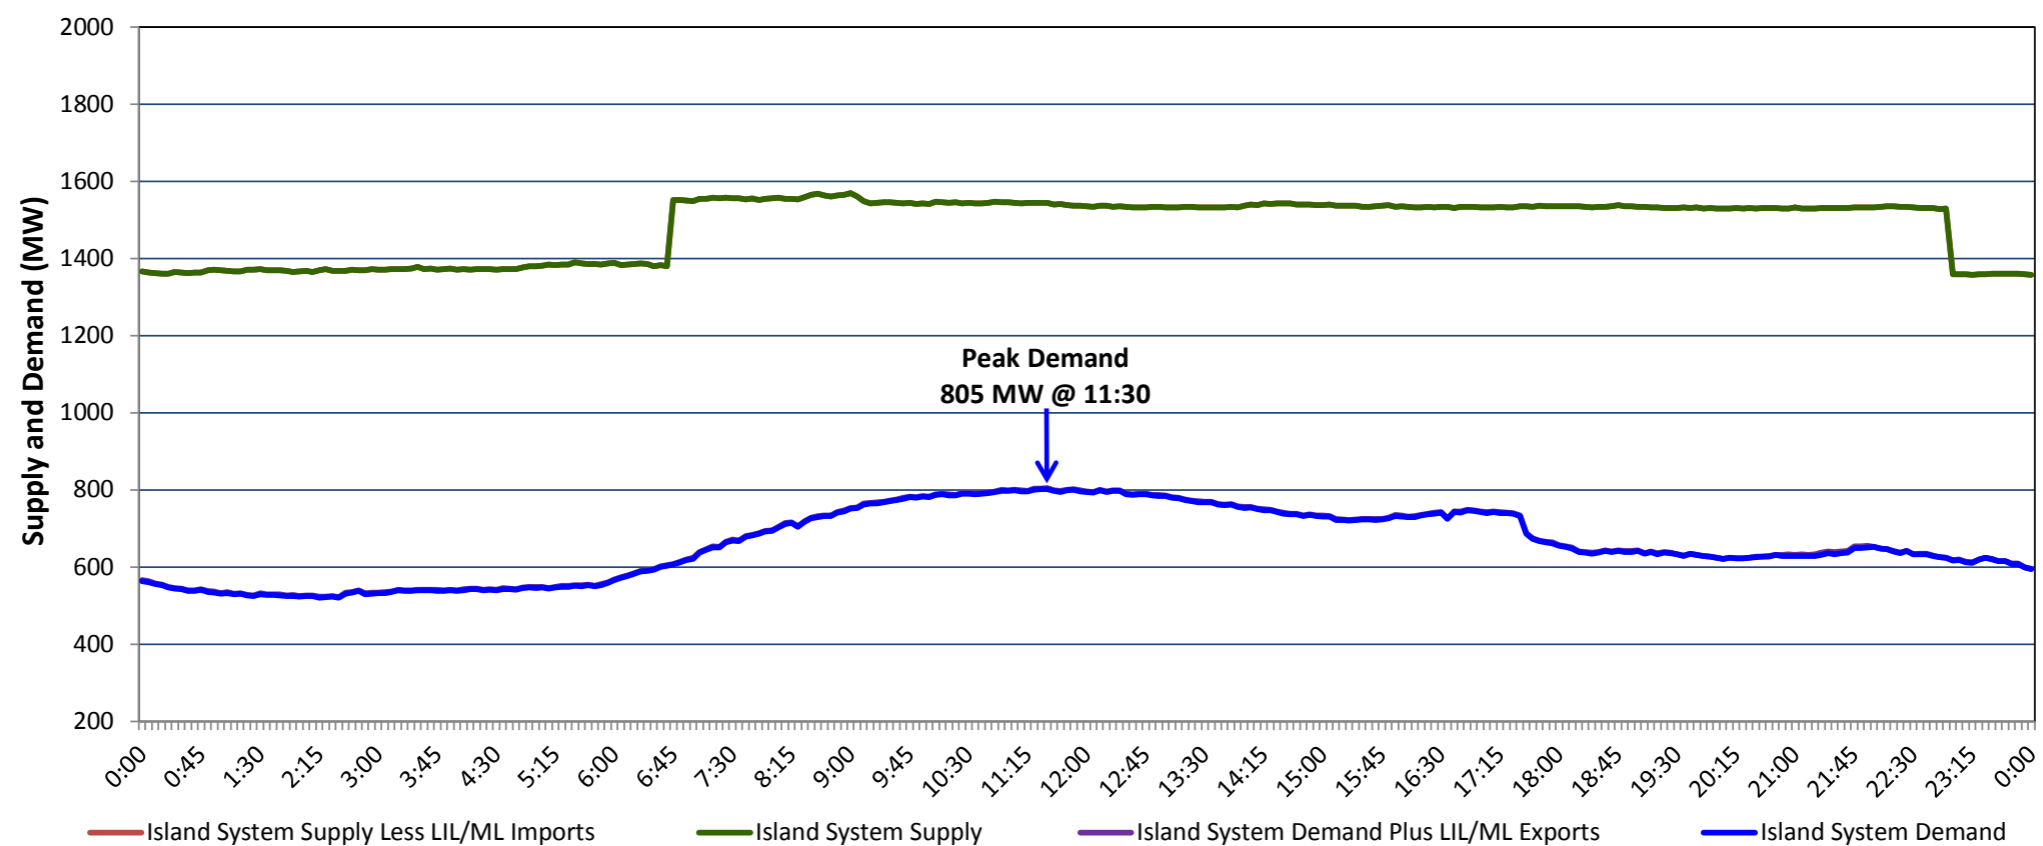

Supply Notes For July 03, 2020

1,2

- A As of 1000 hours, May 31, 2020, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).
- B As of 1415 hours, June 11, 2020, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- C As of 0801 hours, June 19, 2020, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).
- D As of 0853 hours, June 21, 2020, Holyrood Unit 3 available but not operating (150 MW).
- E As of 1452 hours, June 30, 2020, Granite Canal Unit available at 36 MW due to lower than normal water levels (40 MW).
- F At 0643 hours, July 03, 2020, Holyrood Unit 2 available (170 MW).
- G At 2300 hours, July 03, 2020, Holyrood Unit 2 available but offline (170 MW).

**Section 2
Island Interconnected Supply and Demand**

Sat, Jul 04, 2020	Island System Outlook ³		Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
				Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,365	MW	Saturday, July 04, 2020	7	8	760	760
NLH Island Generation: ⁴	1,045	MW	Sunday, July 05, 2020	10	10	760	760
NLH Island Power Purchases: ⁶	105	MW	Monday, July 06, 2020	10	10	765	765
Other Island Generation:	215	MW	Tuesday, July 07, 2020	9	9	795	795
ML/LIL Imports:	-	MW	Wednesday, July 08, 2020	10	11	770	770
Current St. John's Temperature & Windchill:	8 °C	N/A	Thursday, July 09, 2020	12	14	755	755
7-Day Island Peak Demand Forecast:	795	MW	Friday, July 10, 2020	13	12	735	735

Supply Notes For July 04, 2020

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Fri, Jul 03, 2020	Actual Island Peak Demand ⁸	11:30	805 MW
Sat, Jul 04, 2020	Forecast Island Peak Demand		760 MW

Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).