


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, September 07, 2021**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Monday, September 06, 2021**

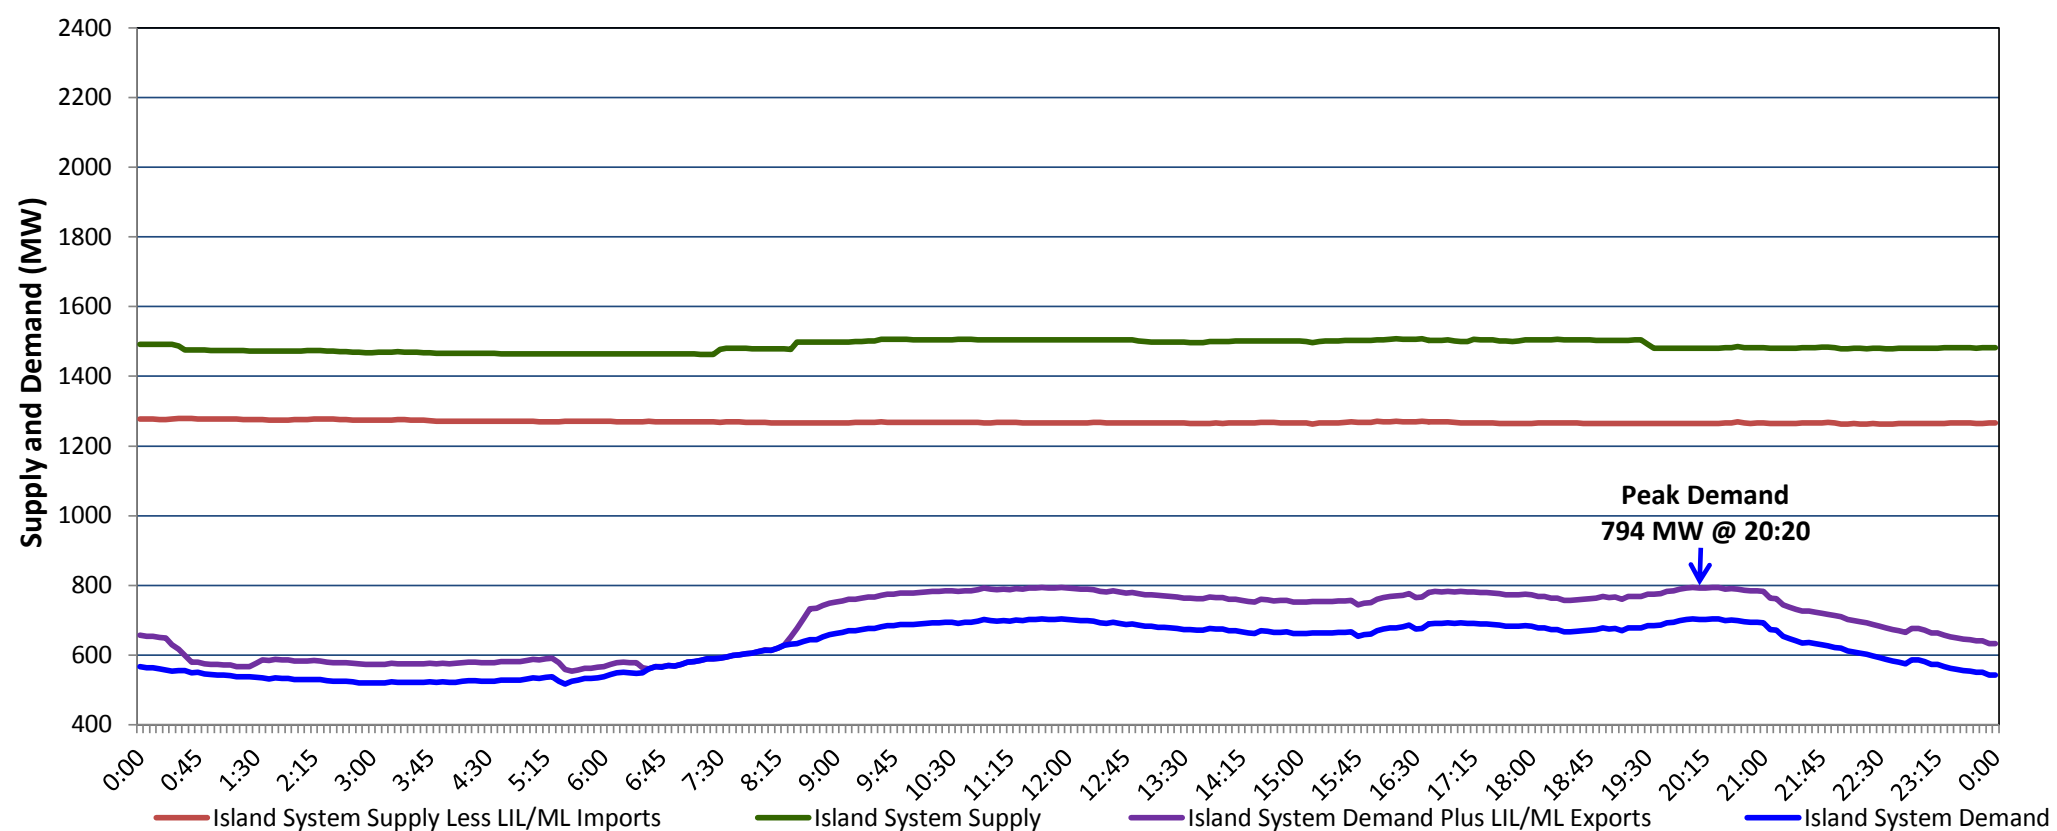

Supply Notes For September 06, 2021

- A As of 0804 hours, May 26, 2021, Holyrood Unit 1 unavailable due to planned outage (170 MW).
- B As of 0850 hours, July 25, 2021, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- C As of 1051 hours, July 25, 2021, Bay d'Espoir Unit 6 unavailable due to planned outage (76.5 MW).
- D As of 1052 hours, August 01, 2021, Upper Salmon Unit unavailable due to planned outage (84 MW).
- E As of 1500 hours, August 12, 2021, Holyrood Unit 2 unavailable due to planned outage (170 MW).
- F At 0700 hours, September 06, 2021, Holyrood Unit 3 available but not operating (150 MW).

**Section 2
Island Interconnected Supply and Demand**

Tue, Sep 07, 2021	Island System Outlook ³			Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,510	MW		Tuesday, September 07, 2021	13	17	850	850
NLH Island Generation: ^{4,8}	965	MW		Wednesday, September 08, 2021	17	18	735	735
NLH Island Power Purchases: ⁶	115	MW		Thursday, September 09, 2021	14	14	755	755
Other Island Generation:	220	MW		Friday, September 10, 2021	15	16	740	740
ML/LIL Imports:	210	MW		Saturday, September 11, 2021	19	15	710	710
Current St. John's Temperature & Windchill:	13 °C	N/A	°C	Sunday, September 12, 2021	14	13	725	725
7-Day Island Peak Demand Forecast:	850	MW		Monday, September 13, 2021	15	18	760	760

Supply Notes For September 07, 2021

- Notes:
- Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 - Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 - As of 0800 Hours.
 - Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 - Gross output from all Island sources (including Note 4).
 - NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 - Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
 - Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Mon, Sep 06, 2021	Actual Island Peak Demand ⁸	20:20	794 MW
Tue, Sep 07, 2021	Forecast Island Peak Demand		850 MW

- Notes: 8. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).