


## Newfoundland Labrador Hydro (NLH) Supply and Demand Status Report Filed Thursday, May 11, 2023

### Section 1 Island Interconnected System Supply, Demand & Exports Actual 24 Hour System Performance For Wednesday, May 10, 2023

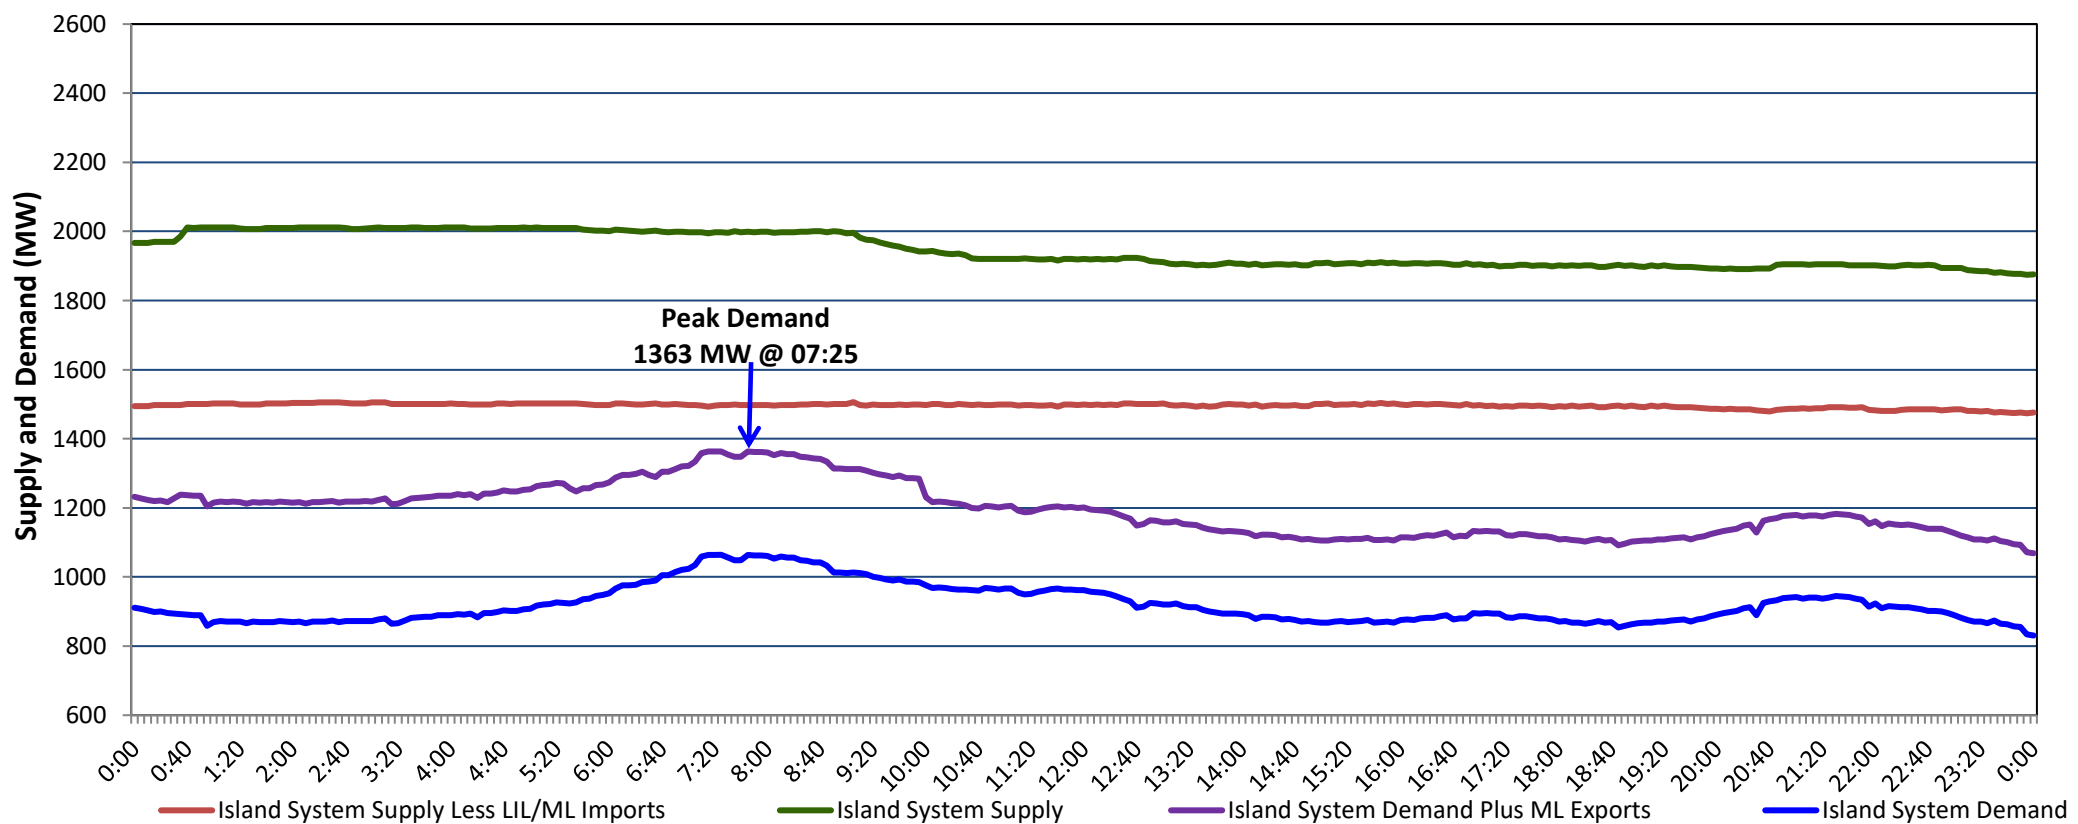

#### Supply Notes For May 10, 2023

1,2

- A As of 0701 hours, March 06, 2023, Upper Salmon Unit unavailable due to planned outage (84 MW).  
 B As of 2005 hours, April 02, 2023, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).  
 C As of 0006 hours, April 09, 2023, Holyrood Unit 3 unavailable due to planned outage (150 MW).  
 D As of 0937 hours, May 01, 2023, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).  
 E As of 1035 hours, May 02, 2023, Holyrood Unit 1 unavailable due to planned outage (170 MW).

### Section 2 Island Interconnected Supply and Demand

Thu, May 11, 2023	Island System Outlook <sup>3</sup>		Seven-Day Forecast		Temperature (°C)		Island System Daily Peak Demand (MW)	
					Morning	Evening	Forecast	Adjusted <sup>7</sup>
Available Island System Supply: <sup>5</sup>	1,890	MW	Thursday, May 11, 2023		3	5	1,290	1,290
NLH Island Generation: <sup>4,8</sup>	1,135	MW	Friday, May 12, 2023		4	3	995	995
NLH Island Power Purchases: <sup>6</sup>	115	MW	Saturday, May 13, 2023		5	3	930	930
Other Island Generation:	215	MW	Sunday, May 14, 2023		7	4	915	915
ML/LIL Imports:	425	MW	Monday, May 15, 2023		3	6	1,005	1,005
Current St. John's Temperature & Windchill:	1 °C	N/A °C	Tuesday, May 16, 2023		7	7	935	935
7-Day Island Peak Demand Forecast:	1,290	MW	Wednesday, May 17, 2023		6	5	910	910

#### Supply Notes For May 11, 2023

3

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
  2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
  3. As of 0800 Hours.
  4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
  5. Gross output from all Island sources (including Note 4).
  6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
  7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
  8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold

### Section 3 Island Peak Demand Information Previous Day Actual Peak and Current Day Forecast Peak

Wed, May 10, 2023	Actual Island Peak Demand <sup>9</sup>	7:25	1,363 MW
Thu, May 11, 2023	Forecast Island Peak Demand		1,290 MW

- Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).