


**Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Wednesday, July 05, 2023**

**Section 1
Island Interconnected System Supply, Demand & Exports
Actual 24 Hour System Performance For Tuesday, July 04, 2023**

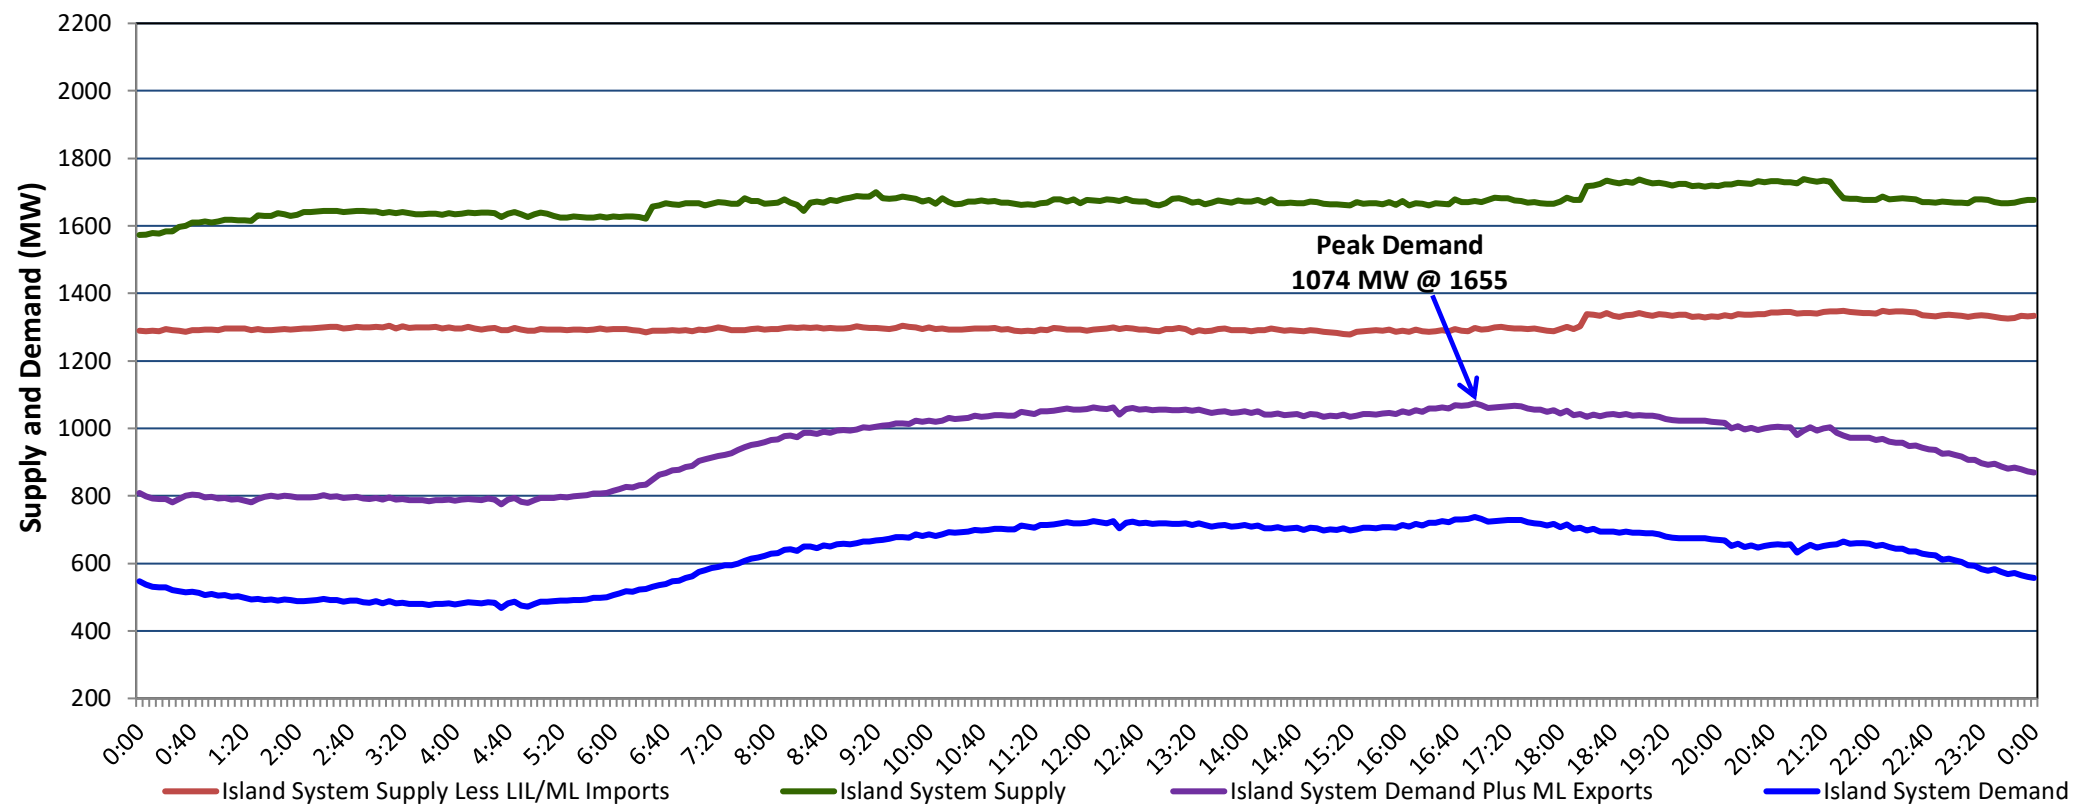

Supply Notes For July 04, 2023

- A As of 0701 hours, March 06, 2023, Upper Salmon Unit unavailable (84 MW).
- B As of 1600 hours, May 15, 2023, Holyrood Unit 1 available but not operating (170 MW).
- C As of 0800 hours, May 21, 2023, Holyrood Unit 2 unavailable due to planned outage (170 MW).
- D As of 1751 hours, May 24, 2023, Bay d'Espoir Unit 5 unavailable due to planned outage (76.5 MW).
- E As of 0803 hours, June 28, 2023, Hardwoods Gas Turbine unavailable due to planned outage (50 MW).
- F As of 0903 hours, June 29, 2023, St. Anthony Diesel Plant available at 8.85 MW (9.7 MW).
- G As of 0856 hours, July 01, 2023, Holyrood Unit 3 available but not operating (150 MW).
- H **At 1818 hours, July 04, 2023, Granite Canal Unit available (40 MW).**

**Section 2
Island Interconnected Supply and Demand**

Wed, Jul 05, 2023	Island System Outlook ³	Seven-Day Forecast	Temperature (°C)		Island System Daily Peak Demand (MW)	
			Morning	Evening	Forecast	Adjusted ⁷
Available Island System Supply: ⁵	1,718 MW	Wednesday, July 5, 2023	18	18	1,120	1,120
NLH Island Generation: ^{4,8}	990 MW	Thursday, July 6, 2023	16	17	715	715
NLH Island Power Purchases: ⁶	125 MW	Friday, July 7, 2023	14	14	740	740
Other Island Generation:	205 MW	Saturday, July 8, 2023	14	15	725	725
ML/LIL Imports:	398 MW	Sunday, July 9, 2023	16	20	735	735
Current St. John's Temperature & Windchill:	19 °C	Monday, July 10, 2023	17	20	775	775
7-Day Island Peak Demand Forecast:	1,120 MW	Tuesday, July 11, 2023	17	18	760	760

Supply Notes For July 05, 2023

- Notes:
1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. The power system operators schedule outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.
 2. Due to the Island system having no synchronous connections to the larger North American grid, when there is a sudden loss of large generating units there may be a requirement for some customer's load to be interrupted for short periods to bring generation output equal to customer demand. This automatic action of power system protection, referred to as under frequency load shedding (UFLS), is necessary to ensure the integrity and reliability of system equipment. Under frequency events have typically occurred 5 to 8 times per year on the Island Interconnected System and the resultant customer load interruptions are generally less than 30 minutes. With the activation of the Maritime Link frequency controller during the winter of 2018, UFLS events have occurred less frequently.
 3. As of 0800 Hours.
 4. Gross output including station service at Holyrood (24.5 MW) and improved NLH hydraulic output due to water levels (35 MW).
 5. Gross output from all Island sources (including Note 4).
 6. NLH Island Power Purchases include: CBPP Co-Gen, Nalcor Exploits, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).
 7. Adjusted for curtailable load, market activities and the impact of voltage reduction when applicable.
 8. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold

**Section 3
Island Peak Demand Information
Previous Day Actual Peak and Current Day Forecast Peak**

Tue, Jul 04, 2023	Actual Island Peak Demand ⁹	16:55	1,074 MW
Wed, Jul 05, 2023	Forecast Island Peak Demand		1,120 MW

Notes: 9. Island Demand / LIL / ML Exports (where applicable) is supplied by NLH generation and purchases, plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).