


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Tuesday, April 22, 2025

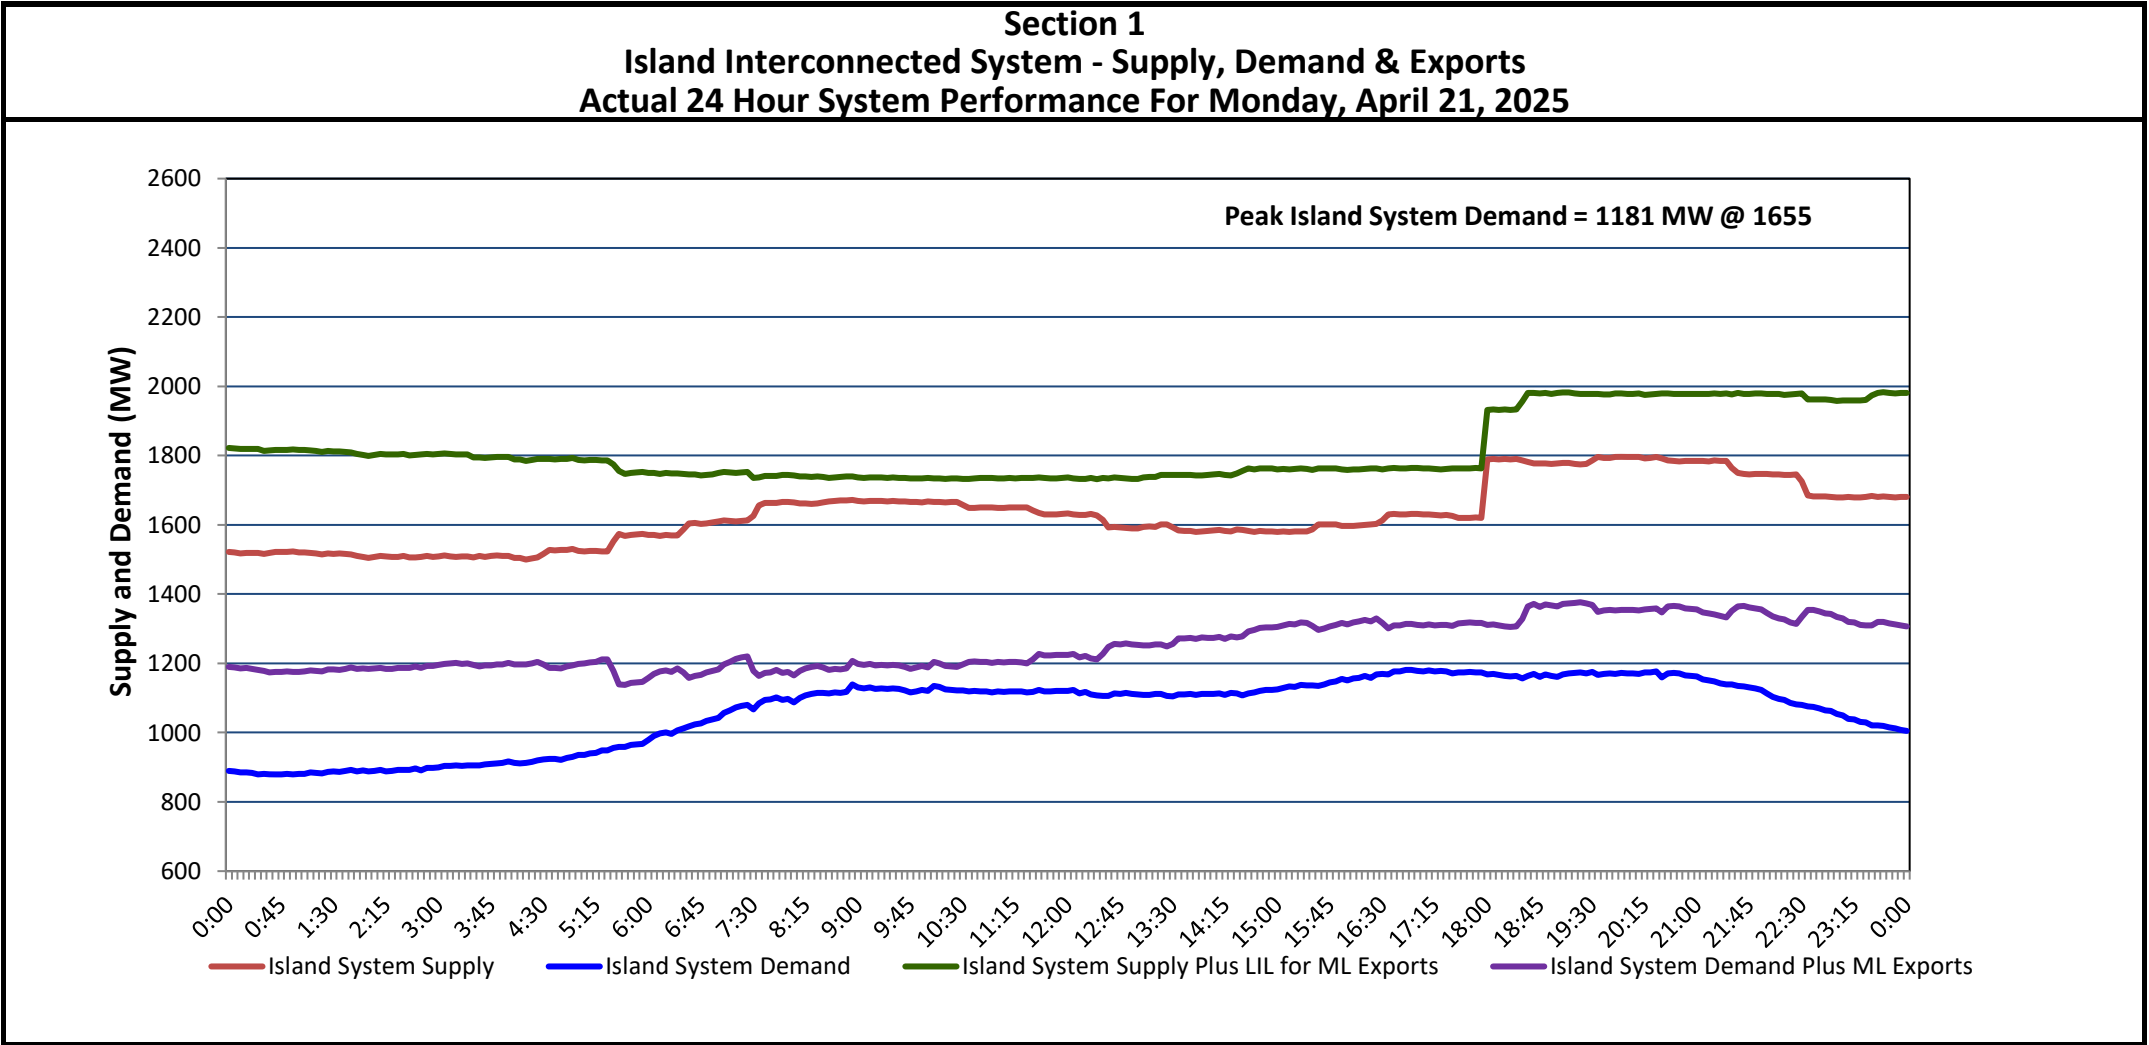

Island Supply Notes For April 21, 2025

A

As of 0952 hours, March 11, 2025, Granite Canal Unit available at 32 MW due to forced derating (40 MW).

B

As of 0816 hours, March 26, 2025, St. Anthony Diesel Plant available at 8.85 MW due to forced derating (9.7 MW).

C

As of 0800 hours, March 30, 2025, Holyrood Unit 3 unavailable due to planned outage 130 MW (150 MW).

D

As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).

E

As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).

F

As of 1320 hours, April 17, 2025, Holyrood Unit 1 available at 105 MW due to forced derating (170 MW).

G

At 1759 hours, April 21, 2025, Holyrood Unit 2 available (170 MW).

Section 2
Island Interconnected System - Supply, Demand & Outlook

Tue, Apr 22, 2025	Island System Outlook ²	Seven-Day Forecast	Island System Daily Peak Demand (MW)	
			Forecast ⁸	Adjusted ⁶
Island System Supply: ⁴ NLH Island Generation: ^{3,7} NLH Island Power Purchases: ⁵ NP and CBPP Owned Generation: LIL/ML Net Imports to Island: ⁹	1,862 MW	Tuesday, April 22, 2025	1,205	1,111
	1,315 MW	Wednesday, April 23, 2025	1,180	1,086
	140 MW	Thursday, April 24, 2025	1,185	1,091
	220 MW	Friday, April 25, 2025	1,150	1,057
	187 MW	Saturday, April 26, 2025	1,075	983
		Sunday, April 27, 2025	1,085	992
		Monday, April 28, 2025	1,175	1,081
7-Day Island Peak Demand Forecast:				
			1,205 MW	

Island Supply Notes For April 22, 2025

Notes:

1.

Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.

2.

As of 0800 Hours.

3.

Gross continuous unit output.

4.

Gross output from all Island sources (including Note 3).

5.

NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).

6.

Adjusted for interruptible load and the impact of voltage reduction when applicable.

7.

Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

8.

Does not include ML Exports.

9.

LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.

Section 3
Island Peak Demand and Exports Information
Previous Day Actual Peak and Current Day Forecast Peak

Mon, Apr 21, 2025	Island Peak Demand ¹⁰	16:55	1,181 MW
	Exports at Peak		133 MW
	LIL Net Imports to Island		2,623 MWh
Tue, Apr 22, 2025	Forecast Island Peak Demand		1,205 MW

Notes:

10.

Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).