


Newfoundland Labrador Hydro (NLH)
Supply and Demand Status Report Filed Monday, June 16, 2025

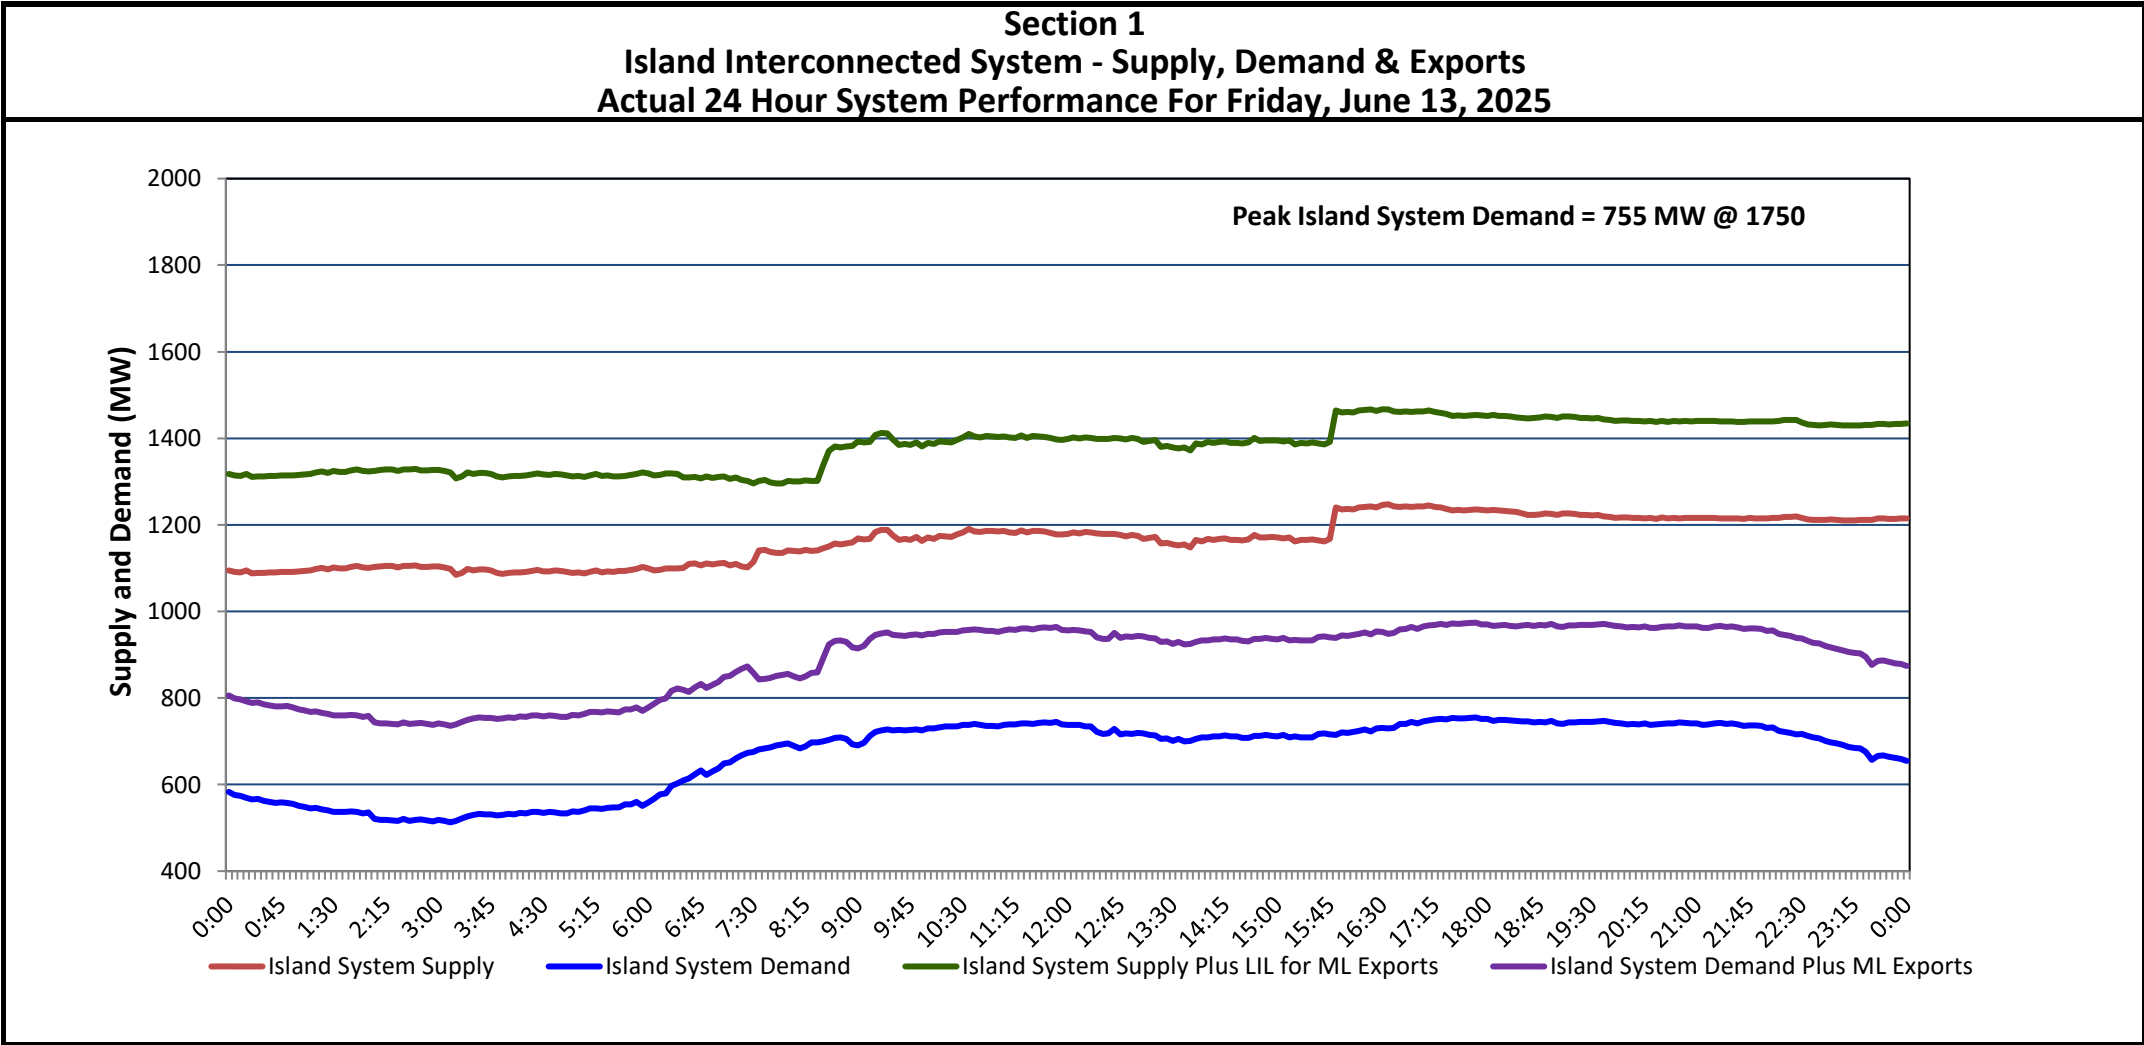

Island Supply Notes For June 13, 2025¹

A	As of 0800 hours, March 30, 2025, Holyrood Unit 3 unavailable due to planned outage 130 MW (150 MW).
B	As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 1 unavailable due to planned outage (76.5 MW).
C	As of 0823 hours, March 31, 2025, Bay d'Espoir Unit 2 unavailable due to planned outage (76.5 MW).
D	As of 0800 hours, May 04, 2025, Holyrood Unit 1 unavailable due to planned outage (170 MW).
E	As of 0851 hours, May 05, 2025, Hardwoods Gas Turbine unavailable due to planned outage (50 MW).
F	As of 1538 hours, May 16, 2025, Holyrood Diesels available at 8 MW due to forced derating (10 MW).
G	As of 0852 hours, May 27, 2025, Bay d'Espoir Unit 3 unavailable due to planned outage (76.5 MW).
H	As of 0852 hours, May 27, 2025, Bay d'Espoir Unit 4 unavailable due to planned outage (76.5 MW).
I	As of 1140 hours, June 02, 2025, Hawkes Bay Diesel Plant available at 2.5 MW due to forced derating (5 MW).
J	As of 1126 hours, June 04, 2025, St. Anthony Diesel Plant available at 6.7 MW due to forced derating (9.7 MW).
K	As of 0800 hours, June 08, 2025, Holyrood Unit 2 unavailable due to planned outage 115 MW (170 MW).
L	At 1547 hours, June 13, 2025, Hinds Lake Unit available (75 MW).

Section 2
Island Interconnected System - Supply, Demand & Outlook

Sat, Jun 14, 2025	Island System Outlook ²	Seven-Day Forecast	Island System Daily Peak Demand (MW)	
			Forecast ⁸	Adjusted ⁶
Island System Supply: ⁴ NLH Island Generation: ^{3,7} NLH Island Power Purchases: ⁵ NP and CBPP Owned Generation: LIL/ML Net Imports to Island: ⁹	1,314 MW 840 MW 85 MW 210 MW 179 MW	Saturday, June 14, 2025	825	775
		Sunday, June 15, 2025	755	705
		Monday, June 16, 2025	785	735
		Tuesday, June 17, 2025	780	730
		Wednesday, June 18, 2025	770	720
		Thursday, June 19, 2025	770	720
7-Day Island Peak Demand Forecast:		825 MW	Friday, June 20, 2025	790

Island Supply Notes For June 14, 2025

M	At 0000 hours, June 14, 2025, Bay d'Espoir Unit 3 unavailable due to forced extension to planned outage (76.5 MW).
N	At 0000 hours, June 14, 2025, Bay d'Espoir Unit 4 unavailable due to forced extension to planned outage (76.5 MW).

Notes:

1. Generation outages for running and corrective maintenance are included. These are not unusual for power system operations. They generally do not impact customer supply. Hydro schedules outages to system equipment whenever possible to coincide with periods when customer demands are low and sufficient supply reserves are available. However, from time to time equipment outages are necessary and reserves may be impacted.

2. As of 0800 Hours.

3. Gross continuous unit output.

4. Gross output from all Island sources (including Note 3).

5. NLH Island Power Purchases include: ML Imports, Exploits Generation, Rattle Brook, Star Lake, Wind Generation and capacity assistance (when applicable).

6. Adjusted for interruptible load and the impact of voltage reduction when applicable.

7. Due to limitations inherent in the design of combustion turbines, the output of combustion turbines may be reduced in the event that ambient temperatures exceed the threshold required for full rated output. This threshold is dependent on the design of each turbine.

8. Does not include ML Exports.

9. LIL Import sunk in the Island System. Actual LIL flows will be restricted by various system conditions including, but not limited to, Island Load, ML Exports and Avalon Unit status.

Section 3
Island Peak Demand and Exports Information
Previous Day Actual Peak and Current Day Forecast Peak

Fri, Jun 13, 2025	Island Peak Demand ¹⁰	17:50	755 MW
	Exports at Peak		219 MW
	LIL Net Imports to Island		1,765 MWh
Sat, Jun 14, 2025	Forecast Island Peak Demand		825 MW

Notes:

10. Island Demand is supplied by NLH generation and purchases, LIL Imports plus generation owned and operated by Newfoundland Power and Corner Brook Pulp & Paper (Deer Lake Power, DLP).